



FILED

01-05-11

04:59 PM

**BEFORE THE PUBLIC UTILITIES COMMISSION OF THE
STATE OF CALIFORNIA**

In the Matter of the Application of SOUTHERN) Application No. 10-12-017
CALIFORNIA EDISON COMPANY (U 338-E))
for a Permit to Construct Electrical Facilities) (Filed December 29, 2010)
With Voltages Between 50 kV and 200 kV:)
Falcon Ridge Substation Project)
)
)
)

SOUTHERN CALIFORNIA EDISON COMPANY'S (U 338-E) DECLARATION
CONCERNING NOTICE PURSUANT TO GENERAL ORDER 131-D, SECTION XI,
SUBPARAGRAPHS A.1 AND A.3

STEPHEN E. PICKETT
RICHARD TOM
SUMNER KOCH

Attorneys for
SOUTHERN CALIFORNIA EDISON COMPANY

2244 Walnut Grove Avenue
Post Office Box 800
Rosemead, California 91770
Telephone: (626) 302-4430
Facsimile: (626) 302-1926
Email: richard.tom@sce.com

Dated: January 5, 2011

**BEFORE THE PUBLIC UTILITIES COMMISSION OF THE
STATE OF CALIFORNIA**

In the Matter of the Application of SOUTHERN)	Application No. 10-12-017
CALIFORNIA EDISON COMPANY (U 338-E))	
for a Permit to Construct Electrical Facilities)	(Filed December 29, 2010)
With Voltages Between 50 kV and 200 kV:)	
Falcon Ridge Substation Project)	
)	
)	
)	

**SOUTHERN CALIFORNIA EDISON COMPANY'S (U 338-E) DECLARATION
CONCERNING NOTICE**

Southern California Edison submits for filing the Declaration of Kim Koeppen concerning the mailing and posting of the notice of the filing of an application for a permit to construct as required by General Order 131-D, Section XI, subparagraph A.3.

Respectfully submitted,

/s/ Richard Tom

By: Richard Tom

Attorney for
SOUTHERN CALIFORNIA EDISON COMPANY

2244 Walnut Grove Avenue
Post Office Box 800
Rosemead, California 91770
Telephone: (626) 302-4430
Facsimile: (626) 302-1926
Email: richard.tom@sce.com



Kim Koeppen
Project Manager

DECLARATION

I, Kim Koeppen, am Southern California Edison Company's (SCE) project manager for the Falcon Ridge Substation Project. I am informed and believe that SCE posted and mailed its notice of filing the Application of SCE for a Permit to Construct the Falcon Ridge Substation Project, as required by General Order 131-D, Section XI, subparagraphs A.1. and A.3.

On December 30, 2010, SCE posted its Notice of Application for a Permit to Construct the Falcon Ridge Substation Project, at the proposed site (located between Sierra Avenue and Mango Avenue north of Summit Avenue in Fontana), along the line routes including at all right-of-way crossings and access points, and at both the Alder 66/12 kV Substation (located on the southeast corner of State Route 210 and Locust Avenue) and the Etiwanda 220/66 kV Substation (located south of Foothill Boulevard and west of Etiwanda Avenue). A map of the Project is attached as Attachment A, and copy of the notice is attached as Attachment B.

All required mailings were sent on December 29, 2010 (See APPLICATION OF SOUTHERN CALIFORNIA EDISON COMPANY (U 338 E) FOR A PERMIT TO CONSTRUCT ELECTRICAL FACILITIES WITH VOLATAGES BETWEEN 50 KV and 200 KV: FALCON RIDGE SUBSTATION PROJECT, Appendix E).

I declare under penalty of perjury that the foregoing is true and correct.

Executed this 5th day of January, 2011, at Rosemead, California.

/s/ Kim Koeppen

Kim Koeppen


Project Manager

Project Licensing

SOUTHERN CALIFORNIA EDISON COMPANY

Attachment A

Map of Falcon Ridge Substation Project

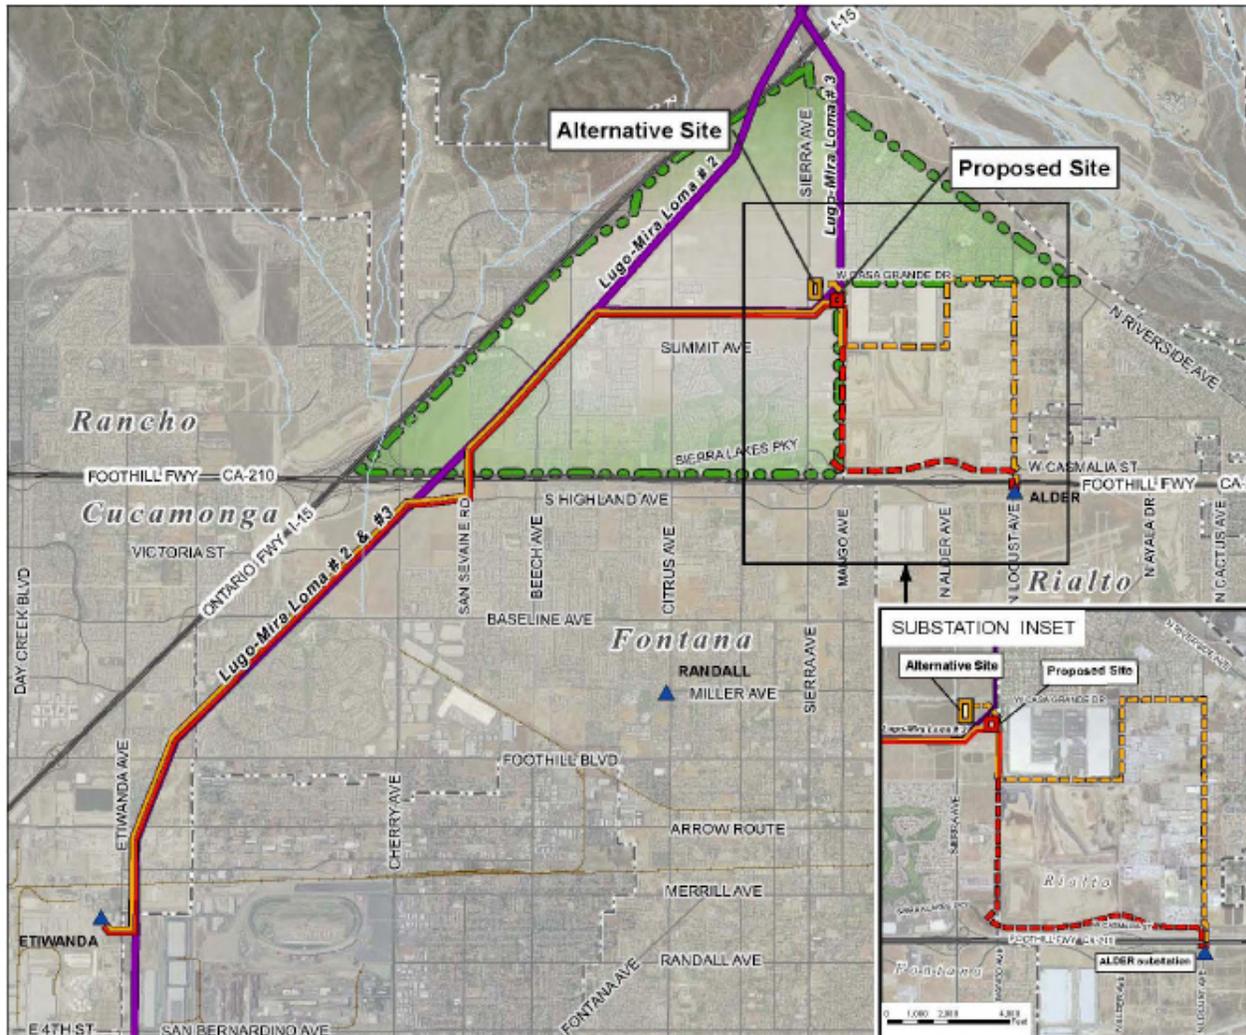

Attachment B

NOTICE OF APPLICATION FOR A PERMIT TO CONSTRUCT

NOTICE OF APPLICATION FOR A PERMIT TO CONSTRUCT

FALCON RIDGE SUBSTATION PROJECT

Date: December 29, 2010

Proposed Project: Southern California Edison Company (SCE) has filed an application with the California Public Utilities Commission (CPUC) for a Permit to Construct (PTC) for the Falcon Ridge Substation Project (Proposed Project). The Proposed Project includes the following elements:

- Construction of a new 66/12 kilovolt (kV) distribution substation on an approximately 7.5-acre parcel generally located south of Casa Grande Avenue, east of Sierra Avenue, north of Summit Avenue and adjacent to SCE's existing transmission right-of-way in the City of Fontana.
- Installation of two new 66 kV subtransmission source lines to connect the proposed Falcon Ridge Substation to the existing Alder 66/12 kV Substation and Etiwanda 220/66 kV Substation. The two source lines are approximately 3 miles and 9 miles in length, respectively.
- Construction of three new underground 12 kV distribution getaways.
- Installation of new telecommunications facilities to connect the Proposed Substation to the SCE telecommunications network.

Demand for electricity in the San Bernardino County area, including the cities of Fontana, Rialto, and Rancho Cucamonga continues to grow and is projected to exceed the capacity of SCE's local electrical system. The increased demand is due in part to growth in existing customer demand, and in part to planned new development projects in the region. SCE projects that its electrical facilities in the area will reach full capacity by 2014 and SCE's existing facilities do not have the capacity to handle the projected increased demand. Therefore, SCE is proposing the Falcon Ridge Substation Project to meet the growing demand, improve reliability, and improve operational flexibility by providing the ability to transfer load between two nearby 66/12 kV substations, Alder Substation and Randall Substation. These substations are located in the cities of Rialto and Fontana, respectively.

Construction is scheduled to begin in the late summer 2013. The Proposed Project is planned to be operational by June 2014.

Environmental Assessment: SCE has prepared a Proponent's Environmental Assessment (PEA) which includes analysis of potential environmental impacts that could be created by the construction and operation of the Proposed Project. The PEA concludes that with the implementation of Applicant-Proposed Measures (APMs), the majority of the potential significant environmental effects associated with the Proposed Project would be reduced to less than significant levels. However, impacts to Air Quality would remain significant and unavoidable.

EMF Compliance: The CPUC requires utilities to employ "no-cost" and "low-cost" measures to reduce public exposure to electric and magnetic fields (EMF). In accordance with "EMF Design Guidelines" filed with the CPUC in compliance with CPUC Decisions 93-11-013 and 06-01-042, SCE would implement the following measure(s) for the proposed project:

1. Utilizing subtransmission structure heights that meet or exceed SCE's preferred EMF design criteria
2. Utilizing subtransmission line construction that reduces the space between conductors compared with other design
3. Arranging conductors of proposed subtransmission lines for magnetic field reduction
4. Placing major substation electrical equipment (such as transformers, switchracks, buses and underground duct banks) away from the substation property lines
5. Configuring the transfer and operating buses with the transfer bus closest to the nearest property line

Public Review Process: SCE has filed an application with the CPUC for a PTC for the Proposed Project. Pursuant to the CPUC Rules of Practice and Procedure, any affected party may, no later than **January 28, 2011**, 30 days from the date of this notice, protest, and request that the CPUC hold hearings on the application. If the CPUC as a result of its investigation determines that public hearings should be held, notice shall be sent to each person or entity who is entitled to notice or who has requested a hearing.

All protests must be mailed to the CPUC and SCE concurrently and should include the following:

1. Your name, mailing address, and daytime telephone number
2. Reference to the Project Name identified above
3. A clear and concise description of the reason for the protest

Protest for this Application must be mailed WITHIN 30 CALENDAR DAYS to:

California Public Utilities
Commission
Docket Office, Room 2001
505 Van Ness Avenue
San Francisco, CA 94102

AND

Southern California Edison Co.
Law Dept. - Exception Mail
2244 Walnut Grove Avenue
Rosemead, CA 91770
Attention: Meraj Rizvi

AND

California Public Utilities
Commission
Director, Energy Division
505 Van Ness Avenue, 4th Floor
San Francisco, CA 94102

For assistance in filing a protest, please call the CPUC's Public Advisor in San Francisco at (415) 703-2074, toll free at (866) 849-8390, or by e-mail at public.advisor@cpuc.ca.gov.

To obtain a copy of SCE's Application, or to request further information, please contact:

Christian Nelson
SCE Ontario Service Center
1351 E. Francis Street
Ontario, CA 91761
Phone: (909) 930-8495
Fax: (909) 930-8407
Christian.Nelson@sce.com

Beverly Powell
SCE Redlands Service Center
287 Tennessee Street
Redlands, CA 92373
Phone: (909) 307-6742
Fax: (909) 307-8308
Beverly.Powell@sce.com

CERTIFICATE OF SERVICE

I hereby certify that, pursuant to the Commission's Rules of Practice and Procedure, I have this day served a true copy of **SOUTHERN CALIFORNIA EDISON COMPANY'S (U 338-E) DECLARATION CONCERNING NOTICE PURSUANT TO GENERAL ORDER 131-D, SECTION XI, SUBPARAGRAPHS A.1 AND A.3** on the California Public Utilities Commission (Commission) Chief Administrative Law Judge, by placing the copy in a sealed envelope and causing such envelope to be delivered by hand or by overnight courier to the office of the Commission or other addressee(s).

Karen Clopton
Chief Administrative Law Judge
California Public Utilities Office
505 Van Ness Avenue
San Francisco, CA 94102

Executed this 5th day of January, 2011, at Rosemead, California.

/s/ Meraj Rizvi _____
Meraj Rizvi
Project Analyst
SOUTHERN CALIFORNIA EDISON COMPANY

2244 Walnut Grove Avenue
Post Office Box 800
Rosemead, California 91770