

**BEFORE THE PUBLIC UTILITIES COMMISSION OF THE
STATE OF CALIFORNIA**

In the Matter of the Application of SOUTHERN)	Application No. 10-09-016
CALIFORNIA EDISON COMPANY (U 338-E))	
for a Permit to Construct Electrical Facilities)	(Filed September 17, 2010)
With Voltages Between 50 kV and 200 kV:)	
Lakeview Substation Project)	
)	
)	
)	

**SOUTHERN CALIFORNIA EDISON COMPANY’S (U 338-E) DECLARATION
CONCERNING NOTICE PURSUANT TO GENERAL ORDER 131-D, SECTION XI,
SUBPARAGRAPHS A.1 AND A.3**

On September 17, 2010, Southern California Edison Company (SCE) filed an application (Application) for a permit to construct (PTC) authorizing SCE to construct the proposed project known as the Lakeview Substation Project (Project). SCE hereby submits for filing the Declaration of Rosalie Barcinas concerning the posting of the notice of the filing of an application for a permit to construct as required by General Order 131-D, Section XI, subparagraph A.3.

Appendix E of SCE’s Application contained the list of entities required to be notified pursuant to General Order 131-D, Section XI, subparagraph A.1 (public agencies, owners of land on which the proposed facility would be located, and owners of property within 300 feet of the right-of-way as determined by the most recent local assessor’s parcel roll available to SCE at the time notice was sent). Appendix E also contained the Certificate of Service, dated September 17, 2010, which documents the mailing of the notice to the parties described above. SCE hereby submits for filing the proof of service of the notice on one remaining party (the South Coast Air

Quality Management District) that was inadvertently omitted from the agency list in Appendix E. SCE mailed a copy of the notice to the South Coast Air Quality Management District on approximately September 24, 2010.

Respectfully submitted,

/s/ Kelly O'Donnell

By: Kelly O'Donnell

Attorney for
SOUTHERN CALIFORNIA EDISON COMPANY

2244 Walnut Grove Avenue
Post Office Box 800
Rosemead, California 91770
Telephone: (626) 302-4411
Facsimile: (626) 302-1926
Email: kelly.odonnell@sce.com

Dated: October 14, 2010



Rosalie Barcinas
Project Manager

DECLARATION

I, Rosalie Barcinas, am Southern California Edison Company's (SCE) project manager for the Lakeview Substation Project. I am informed and believe that on September 17, 2010, SCE posted its Notice of Application for a Permit to Construct the Lakeview Substation Project, as required by General Order 131-D, Section XI, subparagraph A.3, at the proposed site (located at intersection of 10th Street and Reservoir Avenue in Lakeview, an unincorporated area in Riverside County), and off-site along the line routes. A map of the Project is attached hereto as Attachment A. A copy of the notice is attached hereto as Attachment B.

I declare under penalty of perjury that the foregoing is true and correct.


Executed this 14th day of October, 2010, at Rosemead, California.

/s/ Rosalie Barcinas
Rosalie Barcinas
Project Manager
Project Licensing
SOUTHERN CALIFORNIA EDISON COMPANY

Appendix A

Map of Lakeview Substation Project

Figure 1. Project Area and Proposed 115 kV Subtransmission Line Routes and Substation Location

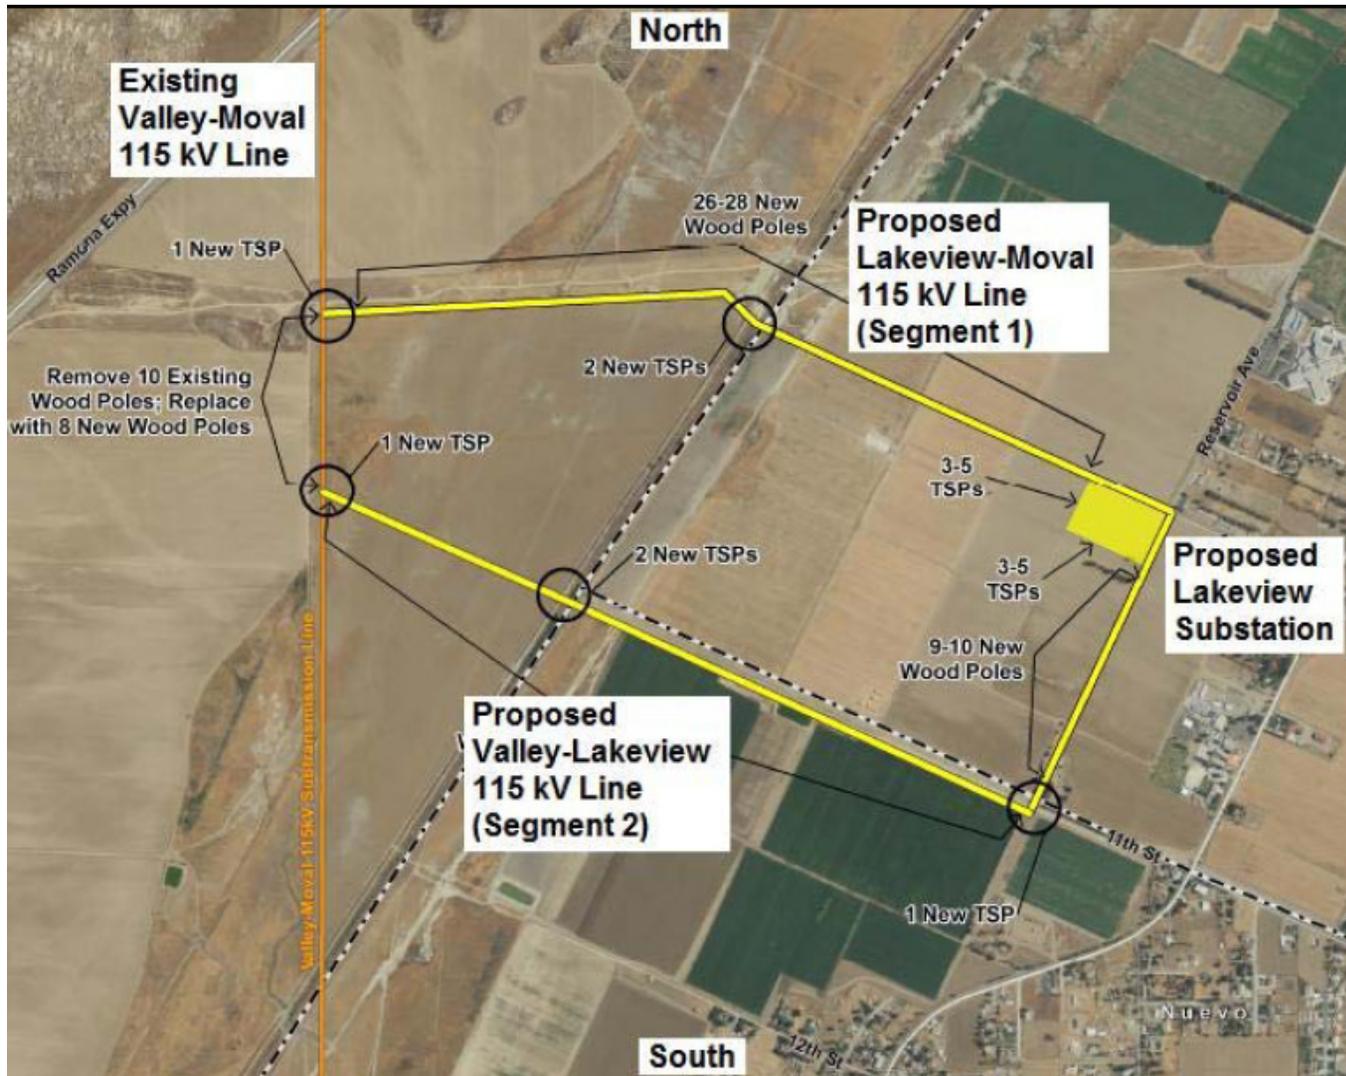

Appendix B

Notice of Application for a Permit to Construct Lakeview Substation Project

NOTICE OF APPLICATION FOR A PERMIT TO CONSTRUCT

LAKEVIEW SUBSTATION PROJECT

Date: September 17, 2010

Proposed Project: Southern California Edison Company (SCE) has filed an application with the California Public Utilities Commission (CPUC) for a Permit to Construct (PTC) for the Lakeview Substation Project (Proposed Project). The Proposed Project includes the following elements:

- Construction of a new 115/12 kV substation (Lakeview Substation). Lakeview Substation would be an unattended, automated 56 MVA 115/12 kV low-profile substation located on a 5.4-acre parcel in unincorporated Riverside County, more specifically the community of Lakeview;
- Installation of two new 115 kV subtransmission source line segments to connect the proposed Lakeview Substation to the existing Valley-Moval 115 kV subtransmission line;
- Construction of two new underground 12 kV distribution getaways;
- Installation of telecommunications facilities at the proposed Lakeview Substation, inclusive of telecommunication cable (overhead and underground) to connect the proposed Lakeview Substation to the SCE telecommunications network, and upgrades to the telecommunications equipment at the various substations; and
- Decommissioning of both Nuevo Substation and Model Pole Top Substation.

Construction is scheduled to begin in the second quarter of 2012. The Proposed Project is scheduled to be operational in June 2013 to ensure that reliable electric service is available to serve customer electric demand.

Environmental Assessment: SCE has prepared a Proponent's Environmental Assessment (PEA) which includes analysis of potential environmental impacts that could be created by the construction and operation of the Proposed Project. The PEA concludes that with the implementation of Applicant-Proposed Measures, the majority of the potential significant environmental effects associated with the Proposed Project would be reduced to less-than-significant levels. However, impacts to agricultural and forestry resources and air quality would remain significant and unavoidable.

EMF Compliance: The CPUC requires utilities to employ "no cost" and "low cost" measures to reduce public exposure to electric and magnetic fields (EMF). In accordance with EMF Design Guidelines filed with the CPUC in compliance with CPUC Decisions 93-11-013 and 06-01-042, SCE would implement the following "no-cost and low-cost" magnetic field reduction design options into the design of the Proposed Project:

1. Utilizing subtransmission structure heights that meet or exceed SCE's preferred EMF design criteria;
2. Utilizing subtransmission line construction that reduces the space between conductors compared with other designs;
3. Placing major substation electrical equipment (such as transformers, switchracks, buses, and underground duct banks) away from the substation property lines; and
4. Configuring the transfer and operating buses with the transfer bus closest to the nearest property line.

Public Review Process: SCE has filed an application with the CPUC for a PTC for the Proposed Project. Pursuant to the CPUC Rules of Practice and Procedure, any affected party may, within 30 days of the date on this notice (i.e. no later than October 17, 2010), protest, and request that the CPUC hold hearings on the application. If the CPUC as a result of its investigation determines that public hearings should be held, notice shall be sent to each person or entity who is entitled to notice or who has requested a hearing.

All protests must be mailed to the CPUC and SCE concurrently and should include the following:

1. Your name, mailing address, and daytime telephone number;
2. Reference to the Project Name identified above; and
3. A clear and concise description of the reason for the protest.

Protest for this Application must be mailed WITHIN 30 CALENDAR DAYS to:

California Public Utilities
Commission
Docket Office, Room 2001
505 Van Ness Ave., 4th Fl.
San Francisco, CA 94102

AND

Southern California Edison Co.
Law Dept. - Exception Mail
2244 Walnut Grove Ave.
Rosemead, CA 91770
Attention: Yolanda Leon

AND

California Public Utilities
Commission
Director, Energy Division
505 Van Ness Ave. 4th Fl.
San Francisco, CA 94102

For assistance in filing a protest, please call the CPUC's Public Advisor in San Francisco at (415) 703-2074 or in Los Angeles at (213) 576-7055.

To review a copy of SCE's Application, or to request further information, please contact:

For Lakeview/Nuevo, CA:

Louis Davis
Region Manager,
Southern California Edison Company
Phone 951-249-8468
FAX 951-249-8653
Louis.Davis@sce.com

CERTIFICATE OF SERVICE

I hereby certify that, pursuant to the Commission's Rules of Practice and Procedure, on approximately September 24, 2010 I served a true copy of the **NOTICE OF APPLICATION OF SOUTHERN CALIFORNIA EDISON COMPANY (U 338-E) FOR A PERMIT TO CONSTRUCT ELECTRICAL FACILITIES WITH VOLTAGES BETWEEN 50 KV AND 200 KV: LAKEVIEW SUBSTATION PROJECT** on the South Coast Air Quality Management District, 73-710 Fred Waring Drive, Palm Desert, California 92260. Service was effected by placing the copy in a properly addressed and sealed envelope and depositing such envelope in U.S. mail with first-class postage prepaid.

Executed this 14th day of October, 2010, at Rosemead, California.

/s/ Meraj Rizvi
Meraj Rizvi
Project Analyst
SOUTHERN CALIFORNIA EDISON COMPANY

2244 Walnut Grove Avenue
Post Office Box 800
Rosemead, California 91770

CERTIFICATE OF SERVICE

I hereby certify that, pursuant to the Commission's Rules of Practice and Procedure, I have on this day served a true copy of **SOUTHERN CALIFORNIA EDISON COMPANY'S (U 338-E) DECLARATION CONCERNING NOTICE PURSUANT TO GENERAL ORDER 131-D, SECTION XI, SUBPARAGRAPHS A.1 AND A.3** on the California Public Utilities Commission (Commission) Chief Administrative Law Judge, by placing the copy in a sealed envelope and causing such envelope to be delivered by hand or by overnight courier to the office of the Commission or other addressee(s).

Executed this 14th day of October, 2010, at Rosemead, California.

/s/ Meraj Rizvi
Meraj Rizvi
Case Analyst
SOUTHERN CALIFORNIA EDISON COMPANY

2244 Walnut Grove Avenue
Post Office Box 800
Rosemead, California 91770