
California Public Utilities Commission

CONSUMER PROTECTION & SAFETY DIVISION UTILITIES SAFETY & RELIABILITY BRANCH NATURAL GAS & PROPANE SAFETY REPORT FOR 2000-2003



August 2005

Headquarters

505 Van Ness Avenue
San Francisco, CA 94102

Sacramento Office

515 "L" Street, Suite 1119
Sacramento, CA 95814

Los Angeles Office

320 West 4th Street, Suite 500
Los Angeles, CA 90013



TABLE OF CONTENTS

Memorandum

I. Introduction..... 1

 A. Purpose of Report..... 1

 B. CPUC’s Responsibilities 1

 1. General Order 112-E.....1

 2. Description of Typical Inspection.....2

 3. Mobile Home Park Program (MHP).....3

 4. Propane Safety Program (PSP).....4

 5. Gas Incident Reports.....6

 6. Safety Related Condition Reports.....8

 7. Drug and Alcohol Program9

 8. Underground Service Alert (USA).....9

 9. Pipeline Replacement Program.....10

 10. Meter Protection Program.....11

 11. Pipe Lining Rather Than Replacement12

 12. Granting of Waivers.....12

 13. Above Ground Pipe Inspections.....13

 14. Seismic Safety Program.....13

 15. Other Programs.....15

 16. Other Duties Required by the Pipeline Safety Act.....16

II. Utility Companies Under the Jurisdiction of the CPUC 19

 A. Natural Gas Companies..... 19

 1. Southern California Gas Company (SCG).....19

 2. Pacific Gas & Electric Company (PG&E).....19

 3. San Diego Gas & Electric Company (SDG&E).....20

 4. Southwest Gas Corporation (SWG).....20

 5. Avista Corporation (Avista).....20

 6. Southern California Edison (SCE).....20

 7. Municipalities21

 a. Palo Alto.....21

 b. Coalinga.....21

 B. Mobile Home Park (MHP) Program.....21

 C. Jurisdictional Propane Systems.....21

	<u>Page No.</u>
III. Size of the California Gas System	22
IV. USRB’s Gas Statistics 2000-2003	
A. G.O. 112-E Inspection Areas.....	34
B. USRB Inspection Data	37
1. Summary of the G.O. 112-E Inspections Conducted, 2000-2003.....	37
2. Tabulation of Utility Inspections Conducted, 2000-2003.....	37
C. Gas Incidents and Customer Complaints.....	38
1. Reportable Incidents by Cause for 2000-2003.....	39
IV. Additional Information	41
A. Publications.....	41
1. How to Order GO 112-E by Phone or mail.....	41
2. How to Order GO 112-E and Federal Regulations on Internet.....	41



LIST OF TABLES AND FIGURES

	<u>Page No.</u>
Table 1. Miles of Distribution Pipeline by Utility.....	24
Figure 1. Distribution Pipeline in Use During 2003.....	25
Figure 2. Percentage of Distribution Pipeline by Utility in 2003.....	25
Table 2. Miles of Transmission Pipeline by Utility.....	26
Figure 3. Transmission Pipeline in Use During 2003	27
Figure 4. Percentage of Transmission Pipeline by Utility in 2003.....	27
Table 3. Number of Services in California by Utility.....	28
Figure 5. Services in 2003 by Utility.....	29
Table 4. Repaired Leaks in California by Utility.....	30
Figure 6. Total Leaks Repaired in 2003.....	31
Figure 7. Leaks Repaired by PG&E in 2003.....	31
Figure 8. Leaks Repaired by SCG in 2003.....	32
Figure 9. Leaks Repaired by SDG&E in 2003.....	32
Figure 10. Leaks Repaired by SWG in 2003.....	33
Table 5. Summary of the G.O. 112-E Inspections Conducted, 2000-2003.....	37
Table 6. Tabulation of Utility Inspections Conducted, 2000-2003.....	37
Table 7. Reportable Incidents by Cause, 2000-2003.....	39
Figure 11. Reportable Incidents by Cause, 2000-2003.....	39



MEMORANDUM

This report presents an account of various activities carried out under the California Public Utilities Commission's (CPUC) natural gas and propane safety programs for the 2000-2003 calendar years. The CPUC has been entrusted with safety jurisdiction over certain natural gas and propane facilities in the state by legislative mandate. It is responsible for enforcing safety regulations, inspecting all work affected by the statutes and making necessary additions and changes to regulations for promoting the safety of the general public and the utility employees that work on the system.

Regulations for the natural gas and propane safety programs are stated in General Order (G.O.) 112-E. G.O. 112-E adopts Title 49 of the Code of Federal Regulations (49 CFR), Parts 190-199 and Part 40 that pertain to natural gas and/or propane safety. G.O. 112-E also includes a few regulations, which are more stringent than the federal regulations. Other pertinent legislation is stated in the Public Utilities Code. The CPUC's Utilities Safety & Reliability Branch (USRB) oversees the safety programs and maintains an adequate level of inspections and surveillance to ensure that these systems are designed, constructed, operated, and maintained in accordance with the regulations for safety of the general public. It also conducts accident investigations, follow-up investigations, compliance inspections, review of utilities' reports and records, construction inspections, and on occasion, conducts special studies regarding pipeline safety.

ACKNOWLEDGMENT

This report was prepared by Jadwindar Singh, Utilities Engineer for the Utilities Safety & Reliability Branch of the Consumer Protection & Safety Division under the general direction of Julian Ajello, Program and Project Supervisor, Zee Wong, Chief, and Richard Clark, Director. The staff also acknowledges the assistance provided by the utilities and other agencies in furnishing data necessary for this report and expresses its appreciation for their cooperation.



I. INTRODUCTION

A. PURPOSE OF REPORT

This Annual Report provides general information about USRB activities and summarizes the progress of its safety programs during the 2000-2003 calendar years. The California Public Utilities Commission (CPUC) monitors the pipeline safety of investor owned gas utilities, mobile home parks and certain propane systems under General Order (G.O.) 112-E. The USRB is charged with enforcing G.O. 112-E, which adopts Title 49 of the Code of Federal Regulations (49 CFR), Sections 190, 191, 192, 193, and 199. The mission of the USRB is to regulate pipeline safety of utilities under Commission jurisdiction and assure an acceptable level of operational safety for the protection of the public and the utilities' employees.

B. CPUC'S RESPONSIBILITIES

1. G.O. 112-E

In 1995, the CPUC adopted the sections of 49 CFR that pertained to gas safety. By CPUC resolution, the current version of 49 CFR was automatically incorporated into G.O. 112-E. The federal government's Department of Transportation (DOT) oversees the Office of Pipeline Safety (OPS) and the Transportation Safety Institute (TSI), which all play a role in modifying the regulations. Since the CPUC receives up to 50% reimbursement from the federal government for carrying out gas safety programs and the CPUC requires a resolution each time it changes G.O. 112-E to adopt any amendments, it made sense to adopt the federal regulations. G.O. 112-E presently retains some California regulations in addition to the federal regulations.

G.O. 112-E requires the USRB to conduct audits of the regulated utilities' natural gas facilities and jurisdictional propane systems. The large utilities are made up of a number of operational

units or divisions, each of which is normally audited every two to three years. When a significant problem is found, the inspection interval is reduced to either one year or six months depending on the severity of the problem. Once the problem is remedied the unit returns to the two to three year inspection cycle.

During these audits, the USRB inspectors review the utilities' Emergency Plans and Operation and Maintenance (O&M) practices looking for deficiencies or oversights. USRB staff reviews leak survey records to determine if the utility is meeting the appropriate standards for repairing leaks. They review the utility's cathodic protection records to assure that corrosion control is being maintained in accordance with the regulations. They insure that the utility is properly certifying its welders and pipe joiners. Finally, they check records pertaining to the anti-drug and alcohol program performed by the company.

The field inspection focuses on verifying the utility records by physically operating valves, checking regulator set points, randomly testing cathodic protection areas, and verifying that repairs have actually been completed. Inspectors also observe the overall condition of the system and how the utility follows its published procedures. The USRB inspectors will cite the utility for noncompliance and specify the time within which corrective action must be taken. The USRB also suggests programs to improve the utilities' performance regarding gas pipeline safety.

2. Description of a Typical G.O. 112-E Inspection

The inspector audits records and pertinent documents in the utility's office and then conducts a field audit to determine if the facilities are operating properly. In the utility's office, the inspector determines if the utility possesses a complete and accurate map of the gas or propane system, an Emergency plan, and an adequate Operation and Maintenance (O&M) plan (with documentation that the plan is being followed). The inspector reviews the utility's records and verifies that the proper maintenance and appropriate surveys, such as cathodic protection, leak detection, and odorant checks were performed in accordance with state and federal regulations. The inspector frequently uses this review of the records as a guide to select the utility facilities to audit in the field.

During the field audit the inspector focuses on the condition and operation of the facilities. For the large utilities, this usually includes measuring the amount of cathodic protection on steel pipes, verifying the set points on overpressure protection devices, visually inspecting above ground facilities, and exercising critical emergency valves to assure they can easily be found and operated. This inspection also may be used to verify the records that were reviewed in the utility's office.

3. Mobile Home Park (MHP) Program

Most natural gas customers in California receive gas directly from and are billed by the local gas utility. However, residents of some mobile home parks do not receive gas directly from the local utility but instead receive gas from and are billed by their mobile home park operator. In this case, the mobile home park is operating as a master meter system. The park receives natural gas at a slight discount since the local utility is not responsible for maintaining and operating the park's natural gas distribution system. The park, in turn, bills its residents at the rates that are prescribed in CPUC's tariffs for the serving utility. The difference between what the master meter operator pays for gas from the utility and what the operator charges its residents is not all profit. Instead, these funds are to be used by the master meter operator to maintain and operate a safe natural gas system within the park. Any money left over becomes profit for the operator.

Under 49 CFR and G.O. 112-E, the MHP program provides for periodic inspections of mobile home park operators who have master meter systems. These operators are expected to meet the requirements outlined in the federal "Guidance Manual for Operators of Small Gas Systems". USRB inspectors are charged with carrying out this program and have the authority to cite operators who are not in compliance with the law. Operators are required to have a map of their system, an emergency plan, and an operation and maintenance plan to assure safe operation of their systems. USRB inspectors verify that the MHP operator knows the requirements of the code and understands the operation and maintenance of the system. USRB engineers also perform a visual inspection of the system to determine if any obvious problems exist.

In addition to inspections, the USRB offers training seminars to master meter operators to reacquaint seasoned operators and introduce new operators to the requirements for operating a gas system. USRB is responsible for inspecting over 2600 master meter mobile home parks in California ranging in size from 2 to over 1,000 customers at least once every five-years. Many of the parks require special attention to meet state requirements. This requires USRB to conduct follow-up inspections of certain operators more than once during the five-year period.

The program has been successful. Many potentially dangerous situations have been found by USRB inspectors and corrected before an incident occurred. USRB logs the results of the inspections in a database and tracks the annual reports. It also follows up to assure operators who have been cited make the appropriate repairs to their systems. The database is also used to identify problem areas, which need to be addressed.

4. Propane Safety Program (PSP)

The Propane Safety Program was precipitated by a number of propane related incidents involving deaths and injuries that occurred in the Sierras in 1992 and 1993. Investigation of these incidents revealed that operators of the propane systems had very little safety regulation. As a result, Assembly Bill (AB) 766 (Hauser) became law on September 1, 1994 and was later amended by AB 2430 on September 19, 1996. The Public Utilities (PU) Code incorporates the law in sections 4451 through 4465. This program directs operators of jurisdictional propane distribution systems in California to comply with the federal pipeline safety standards, and permits the CPUC to adopt rules, at least as stringent as the federal law, to protect the health and safety of the operators, their employees and the customers they serve. The CPUC's responsibility covers all propane distribution systems serving 10 or more customers in a residential or commercial district, and 2 or more customers located in a mobile home park (not to be confused with mobile home parks supplied with natural gas).

Under existing law, the operator is subject to an inspection every two years for those systems that serve over 200 customers. USRB inspectors audit systems that serve at least 100 but less than 200 customers every three years. Approximately 95% of the propane systems serve less than 100 customers and are audited at least once every five years.

The jurisdictional propane systems were identified by using existing databases, conducting phone surveys and making field verifications during the early years of the program. Approximately 750 jurisdictional systems were identified. Of these, approximately 570 were fully audited by USBR inspectors since 1997 and 113 were determined to be non-jurisdictional. As with any new program, USBR inspectors are finding that many operators, who are not suppliers, have little knowledge of their system. In these cases, the inspector becomes an instructor, working with the operator to list necessary actions to increase safety and bring the distribution system into compliance with federal regulations. The operator is then given a date by which to comply. Penalties for non-compliance are outlined in the PU Code. Our inspectors are finding that many operators are hiring consultants to inspect and leak survey their systems prior to our inspections. These operators are striving to comply with the law and as a result the propane systems in California are becoming safer.

USRB inspectors work with the propane industry, mainly through the Western Propane Gas Association (WPGA) to improve the program. Many of the operators of these propane systems also supply the propane. They are usually knowledgeable about the system, safety, and the federal regulations. USBR inspectors listen to the concerns of these operators, and will seek necessary legislation to improve the program, if warranted.

Based on its early experience with this program, the USBR is working at solving several problems. The first problem is capturing all jurisdictional systems in the database and keeping the database current (i.e., removing entities that become non-jurisdictional and adding new entities as they become jurisdictional). There is no existing reliable and comprehensive database of propane master tank operators that contains the information necessary to determine whether they are subject to Commission jurisdiction. Inspectors look for previously undiscovered jurisdictional installations during inspection trips. One obvious source of information to identify propane distribution systems is the propane suppliers who deliver gas to these systems. However, they are not required to provide the USBR any information and generally decline to do so voluntarily unless a customer has been taken away from them.

Second, trends have developed which point out common problems found during our inspections. Cathodic protection and record keeping are prime examples. The USRB is trying to educate not only the small operators, but many of the suppliers, to better understand how cathodic protection works and what they need to do in order to achieve compliance at minimal expense.

In addition to implementing the program, AB 2430 requires the CPUC to collect a user fee from the propane operators under its jurisdiction. At present, the fee is set at twenty-five cents per unit per month or \$3.00 per unit per year. In accordance with the legislation enacted to implement this program, every operator of a propane system serving 10 or more units in a commercial or residential area or 2 or more mobile homes must prepare and submit to the CPUC a completed Annual Report form and pay the annual user fee.

Collecting the user fee is another problem due to the changes in park ownership, park operators, propane suppliers and maintenance staff. Program costs are estimated to be \$300,000 to \$360,000 to inspect approximately 750 jurisdictional operators serving 30,000 customers. Assuming all operators pay the user fee, this program could generate up to \$90,000 annually. This is the only program for which USRB is obligated to bill and collect a user fee.

5. Gas Incident Reports

The USRB monitors and investigates gas incidents, which occur in the service territory of utilities under Commission jurisdiction. The purpose is twofold: first, to determine the cause and whether the utility was negligent or violated G.O. 112-E; and second, to determine if measures can be taken to prevent similar incidents. By keeping a log of the incidents, the staff can track any trends that are occurring in gas incidents and initiate action to prevent them. Tracking leak histories and incident occurrences have led to the “Pipeline Replacement Program”, “Meter Protection Program” and the “Above Ground Pipeline Inspection Program”.

Each utility is required to report any incident which involves 1) death, 2) injury, 3) \$50,000 or more of damage to property, including loss of gas, or 4) in the operator’s judgment is significant, to the CPUC and DOT. These incidents are to be reported to both the CPUC and the DOT within 2 hours (during working hours) and 4 hours (during non- working hours) of the crew

arriving on the scene. The USRB has more stringent incident reporting requirements than the DOT. In addition to the requirements above, the USRB requires the utility to 5) report any incident that involves significant media coverage. The USRB also requires the utility to file a quarterly report listing all reportable and non-reportable incidents that involve the escape of natural gas. This report includes all incidents from minor dig-ins to large incidents that involve fire or explosion, regardless of the amount of property damage. This data is tabulated, analyzed and used to evaluate the need to develop other programs or modify existing ones.

The USRB staff investigates all incidents, but only conducts full scale investigations for those incidents it believes are significant. This may be done by visiting the site, making written data requests, conducting phone interviews with the operator and witnesses of the incident or a combination of these activities. The major cause of gas incidents are “dig-ins” which account for 61% of the reportable gas incidents during 2000-2003. 20% of reportable incidents were caused by “Outside Force” and 15% by vehicles damaging facilities. The remaining 4% were attributed to construction and material defects. Corrosion did not account for any incidents during 2000-2003 (See Figure 11). Many incidents are caused by home owners and small contractors doing work on the customer's property which are not reportable because they do not meet the criteria established by the CPUC or DOT.

On average, about 400 to 500 natural gas incidents are reported to the USRB every year in the utility quarterly reports. Of these, 224 were reported to the USRB as reportable during 2000-2003. Some of the reportable incidents are questionable because they may involve considerable damage, death or injury while the cause is unknown. For example, a house fire started by faulty wiring causes a wall to fall on the gas meter. It is not immediately obvious that the broken gas meter was not the initial cause of the fire. In order to comply with the state and federal rules, the utility tends to assume an incident to be CPUC or DOT reportable if gas *may* have been the cause, and rescinds its notification if gas was found not to be the cause.

During the last four years many of the DOT reportable incidents involved damage over \$50,000. There were very few fatalities or injuries related to natural gas incidents. Most of the reportable incidents that resulted in injury or fatality were caused by attempted suicides, leaks from faulty

gas appliances within the home, or fire. Surprisingly, very few people were injured, as a result of a gas incident.

Some people equate the number of leak repairs to the number of incidents. This is not an accurate comparison. USBR engineers audit the utilities' leak repair records, which include repairs of all leaks, including those caused by incidents. Many of these leaks are detected by leak surveys rather than incident reporting. The following statistics illustrate the causes of repaired leaks in 2003 (See Figure 6):

- 1) Corrosion - 32%
- 2) Third party - 39%
- 3) Outside force - 2%
- 4) Construction defects - 8%
- 5) Material defects - 3%
- 6) Other - 16%

6. Safety Related Condition Reports

Safety Related Condition Reports are required by the DOT to monitor situations that could affect public safety if not repaired in a timely manner. These reports are generally required in the event of a natural disaster, physical damage (e.g., dig-in), corrosion, material defect or operating error causing the integrity of the pipe to be compromised when the pipe cannot be repaired. It usually results in the utility reducing pressure or shutting down the line. The complete definition is found in 49 CFR, Parts 191.23 and 191.25. The utilities appear to dislike monitoring this type of condition and prefer to repair the occurrence as soon as possible. Most utilities prefer to handle it as if it were an incident and repair it in less than five days. As a result, California utilities file a minimum number of "safety-related condition reports" (1-5 per year) during the calendar year.

7. Drug and Alcohol Testing Program

Utility Drug Testing Programs were required by DOT in 1990. Alcohol testing was incorporated in 1995. Each utility is now required to have a drug and alcohol testing program that conforms to the guidelines set forth by DOT in 49 CFR, Parts 40 and 199. In essence, the utility is

required to randomly test utility employees that perform "emergency response functions" in accordance with DOT's procedures. USRB monitors the utility's performance by performing a thorough audit at the utility's headquarters of its Drug and Alcohol Plan. The USRB also audits the medical review officer (MRO), the collection process, drug testing laboratory and the chain of custody of the sample. The headquarters audit is supplemented by information gathered in periodic G.O. 112-E audits of the operator's field offices where questions are asked concerning the utility's Drug and Alcohol Program.

8. Underground Service Alert (USA)

USA was established to minimize the damage caused by dig-ins. USA is funded by its member utilities (gas, electric, water, telephone, cable, etc.) that are at risk of a dig-in. Each USA member pays dues based on either miles of facilities in the ground or population with some weight given to the importance of the buried facilities (e.g., a fiber optic cable or large high pressure gas line has more importance than a 2 inch water line). The function of USA is to provide a single 1-800 number for excavators to call (One call system) 48 hours before they dig. USA notifies utilities that have facilities in the area to locate and mark them so the excavator will be aware of their location prior to digging.

Calls made to the 1-800 number are directed to one of two USA organizations in California; one serving northern California and the other serving southern California. Approximately 600,000 calls are made annually to the two locations. Of these calls, less than one-half of one percent result in a contractor damaging a pipeline. Major contractors tend to call before they dig. Some small contractors and homeowners appear to be unaware of the need to call before they dig and therefore, learn by an unfortunate experience. Even though violators are subject to fines, they are rarely levied. The USRB has endeavored to promote legislation to increase penalties for not calling USA, especially for repeat offenders. The USRB also sends warning letters in particularly egregious cases. Presently, the State Contractor's License Board will revoke contractor licenses if it is determined that the contractor is ignoring the rules. The USRB has recently created a "dig-in" database, which can be used to monitor the effectiveness of the program and determine what companies are repeat offenders.

9. Pipeline Replacement Program (PRP)

The PRP is of paramount importance to a gas utility. Its purpose is to replace old gas pipe, which is technologically obsolete and prone to leakage or failure, with new pipe. Pacific Gas and Electric Company (PG&E) and Southern California Gas Company (SCG) have implemented programs which evaluate the numerous factors that must be considered in determining the priority of replacement. In general, the type of pipe, age, condition, location, proximity of known faults, population density and leak history are the major considerations in setting the priority. As a result of the Loma Prieta earthquake in 1989, seismic effects were added as a major consideration in the formula. At this time, each pipeline segment has a seismic factor which is computed using four factors: (1) the probability of strong ground shaking, (2) the probability of surface faulting, (3) the susceptibility to soil liquefaction and (4) the susceptibility to slope failure or landslide.

PG&E and SCG presently use all these factors to develop a priority list for pipeline replacement. Both programs are well designed and appear to be an accurate method for planning and financing future replacements systematically. Each utility tracks the progress of its program detailing what has been accomplished and what remains to be completed. The priorities are subject to modification with substantial cause. For example, when a utility learns of a planned re-paving project, it may rearrange priorities so that scheduled pipe replacement can be accomplished just before the paving project. Working closely with local public works departments is appreciated because it reduces disruption of traffic. As a result some pipeline replacement projects may be accelerated and others delayed.

Cast iron pipe replacement has always been at or near the top of SCG and PG&E's priority lists. Southwest Gas Corporation (SWG) and San Diego Gas and Electric Company (SDG&E) do not have cast iron pipe in their systems. SCG recently finished replacing the cast iron pipe in its system. PG&E has approximately 300 miles of cast iron pipe (mainly in the San Francisco Bay area) left to replace (as shown by Figure 3). PG&E is systematically replacing these pipes as well as other high priority pipe. PG&E projects that it will complete its cast iron replacement in approximately six years.

Pre-1931 steel distribution mains and steel transmission lines with joint configurations and girth welds not meeting current standards are a high priority on all utility pipeline replacement programs. These pipelines may be higher priority for replacement than cast iron if they operate at higher pressures, are located in highly corrosive areas, are subject to earth movement, are situated in a heavily populated area or have a leak history that logically places them at a greater risk of failure.

Leak surveys and evaluations regarding the cause of recently replaced pipe are used to judge the original pipeline replacement priorities. This coupled with unforeseen events, such as natural disasters, changes in operating conditions, city or county re-paving programs, load shifts and funding all have an impact on the original set of priorities. With proper cause, replacement priorities can and should be modified. USRB monitors these modifications and determines if they are in the best interest of public safety.

10. Meter Protection Program

The meter protection program was initiated because statistics indicated numerous vehicles were hitting meters and rupturing gas pipelines. Upon further investigation of the statistics, it was determined that many of these incidents could have been avoided, if gas meters were either relocated or protected by steel posts. In the late 1980s, gas companies considered meter protection programs in order to minimize the vehicle-caused incidents that occurred in their service territory. In 1990, the Commission ordered gas companies to develop a meter protection program and provide the Commission with annual status reports in order to monitor the utilities' progress. Initially, meter readers were to identify those meters that they felt were vulnerable to being struck by a vehicle. These meters were evaluated by a utility expert and many were slated to be protected. As a direct result of this program, the number of incidents involving a vehicle has decrease substantially.

11. Pipe Lining Rather than Replacement

PG&E requested a waiver from the federal regulations to use a liner in an existing pipeline rather than replacing the pipe. The new technology was less expensive and less disruptive to traffic

than excavating a street and replacing the pipeline. In 1995, PG&E installed this liner in a large main in the San Francisco area. The pipe liner appears to be a cost-effective solution to replacement for pipelines that are prone to leakage. USRB is still monitoring the status of this new technology and how it performs over time. It is through the waiver process that new technologies are tested and if proven to be effective are incorporated into the regulations.

12. Granting Of Waivers

The process of granting waivers initially involves a regulated utility requesting to perform an activity not covered by the existing regulations, or to deviate from existing legislation. In order to use a new product or technology the utility requests USRB to evaluate the merit of the utility's proposal. If USRB is convinced this request has merit, it will prepare a resolution for CPUC approval to grant a waiver contingent upon DOT/OPS approval. If the waiver is granted, the utility may proceed with the project for which the waiver was granted. It cannot use this technology elsewhere until DOT incorporates the new technology into the regulations or the utility requests and is granted a new waiver to use the technology in another project. A good example of how a request for a waiver eventually is incorporated into the regulations is SCG's persistent requests for waivers to install larger diameter polyethylene pipe than allowed by the regulations on various jobs. SCG was convinced that the pipe was safe and economical to use in its system. Eventually the regulations were changed to allow this pipe to be installed.

13. Above Ground Pipe Inspections

Above ground pipeline inspections were initiated in 1990 after significant corrosion was observed on a major transmission line. Inspections revealed big differences in the surface condition of exposed piping in different districts within the same utility. In some districts above ground pipe was in excellent condition while in an adjacent district, there were frequent instances of surface rust and pitting.

As a result of these inspections, USBR is directing some of the utilities to identify all above ground spans, state the general condition of each span, confirm when it was last inspected, identify who conducted the inspection, and indicate when the work will be completed on the span, if needed. When this procedure is refined, USBR will implement the program statewide. All utilities will be required to keep records of above ground facilities and these records will be reviewed during the course of normal G.O. 112-E inspections.

14. Seismic Safety Program

As a result of the Loma Prieta earthquake the Seismic Safety Commission (SSC), which is charged with implementing an earthquake hazards reduction program for the state, set milestones for identifying and mitigating earthquake hazards. The CPUC was designated as the lead agency for utility systems providing critical services. In the process, the SSC set forth the following milestones:

A. Establish, by August 1, 1989, the channels of communications to all parties which have an interest in this sector.

B. Establish, by January 1, 1990, appropriate seismic safety criteria and procedures for design, construction and operation of new facilities, hazard mitigation, and reliability improvement for existing facilities.

C. Establish, by July 1, 1990, suitable emergency response criteria and procedures to assure rapid restoration of services and to facilities repair or replacement of damaged or destroyed systems.

D. Determine, by January 1, 1991 if existing state authority is adequate to assure that seismic safety criteria and procedures will be met.

E. Provide, by July 1, 1991, for any additional state authority required to establish all seismic safety criteria and procedures.

USRB staff met with the SSC after the Loma Prieta earthquake to share information of the progress being made to restore service and to discuss earthquake preparedness. In light of the significant amount of information gathered from the earthquake, the USRB requested, and was granted, an extension of time from the SSC to respond to the milestones previously established by the SSC. The SSC agreed to accept a report from the Commission which would address the following five elements:

1. Policy Statement: A statement of policy that states goals, expectations, and deadlines, and explains the ranking of seismic safety in the agency's responsibilities.
2. Seismic Safety Program: A seismic safety program with a plan and process to identify earthquake hazards to people and to the organization's functions, to abate the unacceptable hazards, and to prudently manage the risks that cannot be eliminated.
3. Responsible Staff: A management level agency official having clear responsibility for meeting the goals in the policy statement, and an appropriately sized staff that has the administrative and technical knowledge and experience needed to carry out the program.
4. Adequate Funds: Funds adequate to carry out the program or a plan to raise the funds needed.

5. **Accountability:** A way to measure and report progress to the person or organization legally responsible for the agency, and to the Governor and the Legislature, and a way to ensure technical performance in carrying out the program.

Since 1990, the USRB has worked with the utilities to insure that the above-mentioned five elements provided the foundation for the utilities' responses, and to determine various seismic considerations, parameters and lessons learned from the Loma Prieta (1989), Northridge (1994) and other earthquakes. It should be noted that many of the preventative measures suggested in this report are currently being considered or have been implemented by the utilities. Further, all utilities were found to be well aware of seismic issues. Damage caused by both the Loma Prieta and the Northridge earthquakes indicates that gas systems survive with relatively minor damage compared with other types of structures in the area of seismic activity.

15. Other Programs

USRB is currently looking at new technology and pragmatic solutions to handle the current concerns in this state to improve gas safety. Paramount on this list is to improve on the existing method to control gas during and immediately after a seismic occurrence. If the interior house/building gas lines are damaged and leaking, it might be useful to have a device that would automatically shut off the gas at the meter. The city of Los Angeles adopted rules to mandate installation of these valves under certain conditions and SCG conducted a pilot program to install these devices. Numerous valves have been installed in southern California at customer expense. False closures of these valves may be a problem. Other firms are working on a product that would sense the presence of gas in the air. The sensor would detect the amount of methane (CH₄) in the environment and possibly carbon monoxide (CO), and at preset levels would shut off the gas supply to the building. The device would also sound an alarm much like a smoke detector notifying the occupants with two alarms: first, that there is a problem and the gas is about to be shut off and second, when the gas is automatically shut off. It is expected that most of the existing seismic shut-off valves will have some problems. USRB believes the real test will come when there is a seismic event that triggers these valves.

The USRB is also looking at better ways to measure the condition of pipelines. Manufacturers are currently developing devices that can be inserted into a gas line, travel through it and locate any areas of corrosion or damage. These devices are called "smart pigs". In time, they will be able to provide video of the interior of the pipe, measure wall thickness, determine where the pipe wrap may have been damaged, positively locate the area of concern and in some cases even repair certain conditions. These smart pigs combined with the improvement of other gas detection devices will improve the safety of the gas systems.

Other devices such as pipe liners capable of being inserted into existing pipes may greatly reduce the cost of pipeline replacement especially in highly populated areas. System Control And Data Acquisition (SCADA) systems are being used to remotely monitor critical pipeline facilities and in some cases, work as an early warning system to alert the utility to a potential problem such as overpressurization. Programs continue to be enacted as a result of information gathered following a natural disaster (e.g., the water heater strapping program resulted from investigations of the causes of natural gas fires following an earthquake).

16. Other Duties Required by the Pipeline Safety Act

The USRB is required to log each of the regulated utilities' major construction projects, uprates and hydro tests. During the process of recording the construction projects, USRB staff also checks the utility's calculations to verify the pipe has adequate wall thickness to carry the pressure. In addition, USRB reviews the type of project (new or replacement), the location of the project, and the pipe material being used. It also performs random inspections of these activities. These inspections are usually conducted when time permits or a significant job warrants an inspection.

The USRB is annually audited by the DOT to verify its ability to perform as an agent for the federal government. Federal funding is based on the results of this audit. The audit consists of reviewing USRB's records of the previous year. Records regarding incident reports, inspections, citations for noncompliance and knowledge of the federal law are reviewed. Person-days spent on auditing utilities and investigating gas incidents are weighted heavily. DOT also accompanies staff inspectors when they perform an audit of the utility. The DOT also requires

the USBR to account for its actions, to have its inspectors fully trained by attending all the required courses at DOT's Transportation Safety Institute (TSI), to implement new rule changes in the federal regulations and to participate in certain annual meetings.

It is expected that a number of new provisions will be looked at during the next few years. Many of these concerns will deal with pipeline safety and effect on the environment. The Pipeline Safety Act of 1992 places the environment on an equal basis with safety in making regulatory decisions. It appears DOT's Office of Pipeline Safety (OPS) is moving ahead with its risk-based planning approach. In its "work redesign" program, it identified the need for better analytical tools to assess the safety and environmental risks of pipeline transportation for long-range planning of activities. OPS is in the process of prioritizing the pipeline risks according to their probability of occurrence and consequences. In proposing solutions, it will consider the finite resources available and the relative costs and benefits to develop programs to address the risks. OPS intends to work with the industry, states, and general public during this process.

OPS and DOT's Research and Special Programs Administration (RSPA) has added Subpart N (192.801 to 192.809) to the Federal Regulations which requires operators of gas systems to have a written "operator qualification program" by April 27, 2001. The operator is required to keep records including the name of the individual, the covered tasks the individual is qualified to perform, the method(s) used to qualify the individual and the date(s) of qualification. These records are to be kept for a minimum of five years under federal requirements. USBR in cooperation with OPS/RSPA and TSI is developing guidelines to evaluate the operator's compliance with the new regulations.

C. SIGNIFICANT RULEMAKING AND DECISIONS

1. Utility Responsibility Regarding Termination of Service for Fumigation

The Commission issued Resolution G-3256 on January 6, 2000, stating that the utility would be responsible for terminating service to a building prior to fumigation. Prior to the complaint that was filed with the Commission, fumigation contractors were allowed to turn off the gas to the building. The tariff revision to Gas Rule 11 was prompted by three gas explosions in residences related to inadequate fumigation service termination policies. The rule established procedures for the fumigation contractor and the utility. The contractor must follow guidelines to notify the utility. If this is done, there is no fee charged by the utility for performing the service. There are penalties prescribed to ensure the contractor follows the guidelines. The utility must react and terminate service on the date requested. The resolution does not address any changes in Gas Rule 11 regarding the restoration of service.



II. UTILITY COMPANIES UNDER THE JURISDICTION OF THE CPUC

The CPUC has been granted authority by the Legislature to adopt and enforce requirements of G.O. 112-E on publicly owned utilities. There are six publicly owned natural gas utility companies within the state and three owned by municipalities with districts formed under the provisions of various laws of the State of California.

A. NATURAL GAS COMPANIES



1. Southern California Gas Company (SCG)

Southern California Gas Company serves almost 4 million customers in southern California. Prior to the unbundling of its gas facilities it was capable of storing over 110 Bcf of natural gas in its 5 underground storage fields which could deliver over one Bcf per day to the system upon demand.



2. Pacific Gas and Electric Company (PG&E)

Pacific Gas and Electric provides gas service to about 3 million customers. Its service area spans 70,000 square miles, including all or portions of 48 of California's 58 counties. Prior to unbundling PG&E had approximately 100 Bcf of underground storage capacity.



3. San Diego Gas and Electric Company (SDG&E)

San Diego Gas and Electric operates under its parent company Sempra Energy and provides natural gas service to approximately 520,000 customers in San Diego and Orange County.



4. Southwest Gas Corporation (SWG)

Southwest Gas provides natural gas service to approximately 110,000 customers in Victorville, Big Bear and North Lake Tahoe within California. The company also serves much of Nevada and Arizona.




5. Avista Corp. (formerly Washington Water Power Co.)

This company serves approximately 15,000 customers at the south end of Lake Tahoe.




6. Southern California Edison Company (SCE)

Edison operates a gas system (propane /butane air) system on Catalina Island that serves approximately 1,000 customers. It also transports gas to one of its power plants. SCE is one of the nations' largest electric utilities, serving more than 11 million customers in a 50,000-square-mile area within Central and Southern California.



7. Municipalities
These California municipalities provide natural gas service to their customers.

- Palo Alto
- Coalinga



8. Natural Gas Storage Facilities
These companies provide natural gas storage service to California's transmission companies.

- Lodi Underground Storage
- West Coast Storage
- Wild Goose Storage

B. MOBILE HOME PARK (MHP) PROGRAM

The Utilities Safety Branch inspects approximately 2,800 mobile home parks over a five year period (560 parks per year plus any re-inspections).

C. JURISDICTIONAL PROPANE SYSTEMS

USRB inspects approximately 700 jurisdictional propane systems under CPUC regulation at least once every five years or over 140 systems per year plus any re-inspections. Larger systems must be inspected every 2 or 3 years depending on their size.



III. SIZE OF THE CALIFORNIA GAS SYSTEM

The California gas system (natural gas and propane) serves approximately 8 million gas customers with over 100,000 miles of gas mains. Table 1, Figure 1, and Figure 2 illustrate the miles and type of distribution pipeline. Table 2, Figure 3, and Figure 4 indicate the miles and type of transmission pipeline. Table 3 and Figure 5 show the number and type of services of each California utility during 2000-2003. Table 4 lists the cause of repaired leaks determined by each utility on their system during 2000-2003. Figure 4 illustrates an overview of the cause of repaired leaks in 2003 while Figures 6 through 10 show the causes by utility for both mains and services in 2003.

Pacific Gas & Electric Company (PG&E) and Southern California Gas (SCG) are two of the largest gas companies in the United States and serve most of northern (PG&E) and southern California (SCG). San Diego Gas & Electric (SDG&E), while a large company in its own right, is significantly smaller and serves the greater San Diego area. Southwest Gas Corporation (SWG) is smaller and serves approximately 110,000 customers in north Lake Tahoe and the high desert area near Victorville. Avista (formerly Washington Water Power Company, CP National and California Pacific Utility Company) is very small in California and serves South Lake Tahoe. Southern California Edison (SCE), one of the largest electric companies in the United States operates a very small gas operation that serves the town of Avalon on Catalina Island. It also operates a gas transmission line in the Los Angeles area to serve one of its generating stations.

Small companies, such as Alpine Natural Gas, are building systems to serve customers who were previously served by propane. Evidently, these companies believe that they can build a system, purchase gas from an existing utility, deliver it, and make a profit. Even though the systems are small, the operators of these systems will fall under CPUC jurisdiction and will be required to follow state and federal regulations. In many ways these systems are similar to the MHP

operators. It is interesting to note the utility in the franchised area chose not to extend its system to serve these customers. USBR will be watching to ensure that safety is not compromised in order to keep the systems viable.

Independent firms are developing underground storage to serve California utilities. Wild Goose Storage Inc., Lodi Underground Storage, and West Coast Storage are under the Commission's jurisdiction for safety regulation. The USBR will inspect and monitor their operations. These firms will be requiring reservation and variable charges from those wishing to use their service. Again, USBR will be concerned about these operators compromising safety for any reason.

Miles of Distribution Pipeline by Utility								
Year	Company	Steel Pipe				Plastic	Cast Iron	Total
		Unprotected		Protected				
		Bare	Coated	Bare	Coated			
2000	PG&E	451	0	0	20,870	16,278	359	37,958
2001		444	0	0	20,787	16,849	329	38,409
2002		438	0	0	20,726	17,482	301	38,947
2003		433	0	0	20,702	18,106	269	39,510
2000	SCG	5,297	5,462	72	15,609	17,649	0	44,089
2001		5,243	5,103	59	15,981	18,173	0	44,559
2002		5,979	2,746	61	17,400	18,765	0	44,951
2003		3,454	5,183	71	17,315	19,451	0	45,474
2000	SDG&E	0	0	0	3,685	3,367	0	7,052
2001		0	0	0	3,681	3,532	0	7,213
2002		0	0	0	3,601	3,636	0	7,237
2003		0	0	0	3,596	3,769	0	7,365
2000	SWG	0	0	0	428	1,823	0	2,251
2001		0	0	0	423	1,883	0	2,306
2002		0	0	0	429	1,944	0	2,373
2003		0	0	0	480	1,985	0	2,465
2000	AVISTA	0	0	0	0	233	0	233
2001		0	0	0	0	233	0	233
2002		0	0	0	0	233	0	233
2003		0	0	0	0	233	0	233
2000	SCE	0	0	0	8,935	0.2	0	9.135
2001		0	0	0	8,935	0.2	0	9.135
2002		0	0	0	8,935	0.2	0	9.135
2003		0	0	0	8,935	0.2	0	9.135
2003	Total	3,887	5,183	71	42,102	43,544	269	95,056

Table 1

Distribution Pipeline in Use During 2003

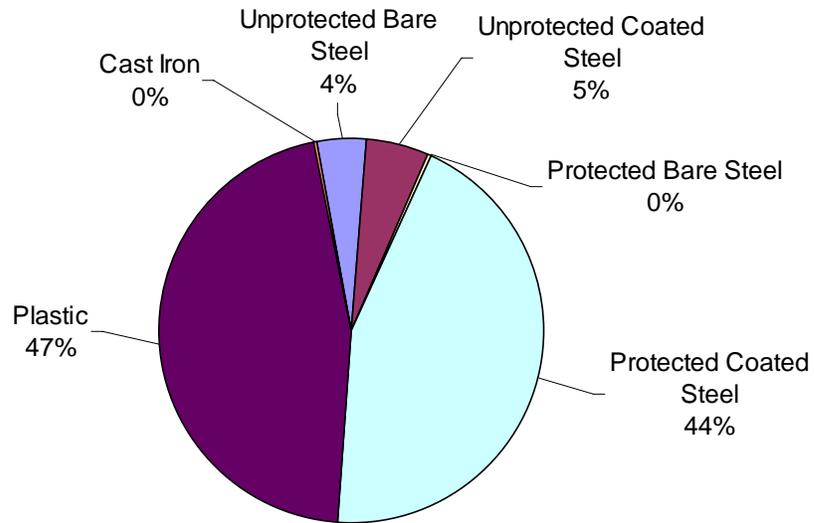


Figure 1

Percentage of Distribution Pipeline by Utility in 2003

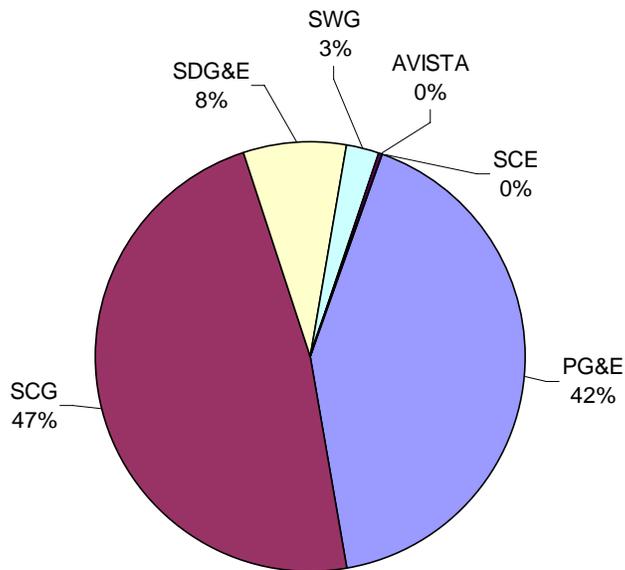


Figure 2

Miles of Transmission Pipeline by Utility						
Year	Company	Steel Pipe				Total
		Unprotected		Protected		
		Bare	Coated	Bare	Coated	
2000	PG&E	18	0	0	5,527	5,545
2001		9	0	0	5,216	5,225
2002		9	0	0	5,388	5,397
2003		9	0	0	5,529	5,538
2000	SCG	67	0	261	3,649	3,977
2001		67	0	259	3,675	4,001
2002		51	0	271	3,720	4,042
2003		51	0	252	3,725	4,028
2000	SDG&E	0	0	0	170	170
2001		0	0	0	72	72
2002		0	0	0	244	244
2003		0	0	0	248	248
2000	SWG	0	0	0	93	93
2001		0	0	0	94	94
2002		0	0	0	83	83
2003		0	0	0	26	26
2000	AVISTA	0	0	0	0	0
2001		0	0	0	0	0
2002		0	0	0	0	0
2003		0	0	0	0	0
2000	SCE	0	0	0	0	0
2001		0	0	0	0	0
2002		0	0	0	0	0
2003		0	0	0	0	0
2003	Total	60	0	252	9,528	9,840

Table 2

Transmission Pipeline in Use During 2003

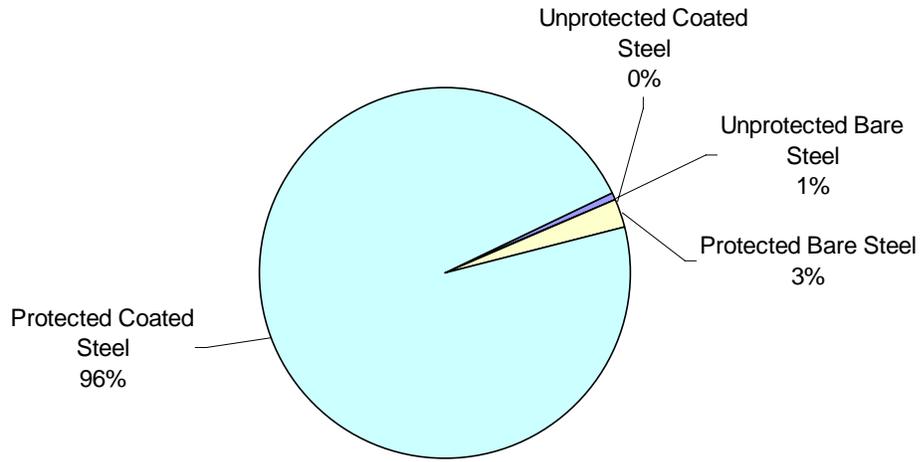


Figure 3

Percentage of Transmission Pipeline by Utility in 2003

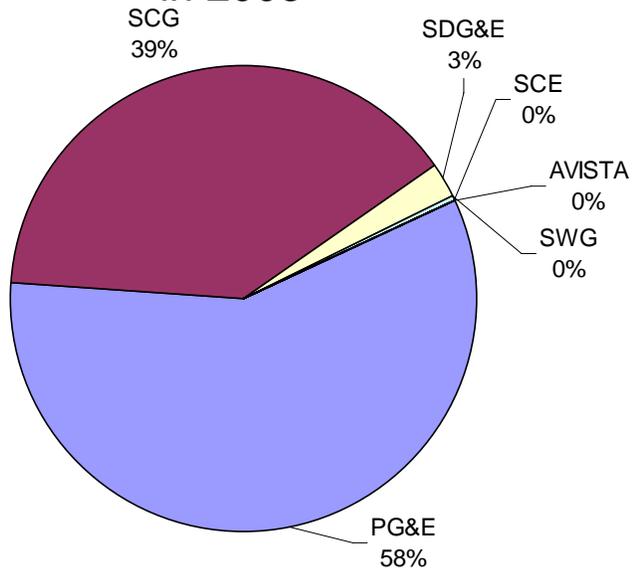


Figure 4

Number of Services in California by Utility								
Year	Company	Steel Pipe				Plastic	Copper	Total
		Unprotected		Protected				
		Bare	Coated	Bare	Coated			
2000	PG&E	49,772	0	0	1,219,690	1,630,852	83,627	2,983,941
2001		45,935	0	0	1,216,115	1,679,450	82,831	3,024,331
2002		45,314	0	0	1,207,501	1,733,125	81,616	3,067,556
2003		30,872	0	0	1,212,190	1,792,576	79,510	3,115,148
2000	SCG	99,737	85,489	6,927	1,562,231	2,042,156	6,002	3,802,542
2001		88,231	84,771	5,328	1,559,177	2,175,630	5,373	3,918,510
2002		24,769	11,376	5,312	1,685,381	2,246,159	5,073	3,978,070
2003		12,193	18,298	6,261	1,676,739	2,327,106	4,173	4,044,770
2000	SDG&E	0	0	0	269,552	276,000	0	545,552
2001		0	0	0	269,094	289,365	0	558,459
2002		0	0	0	268,172	299,271	0	567,443
2003		0	0	0	267,167	301,863	0	569,030
2000	SWG	0	0	0	6,679	111,832	0	118,511
2001		0	0	0	5,112	114,437	0	119,549
2002		0	0	0	5,024	117,277	0	122,301
2003		0	0	0	4,893	120,951	0	125,844
2000	AVISTA	0	0	0	7,847	7,776	0	15,623
2001		0	0	0	7,841	7,912	0	15,753
2002		0	0	0	7,834	8,082	0	15,916
2003		0	0	0	7,833	8,264	0	16,097
2000	SCE	0	0	812	158	0	0	970
2001		0	0	816	163	0	0	979
2002		0	0	816	163	0	0	979
2003		0	0	816	164	0	0	980
2003	Total	43,065	18,298	7,077	3,161,153	4,542,496	83,683	7,855,772

Table 3

Services in 2003 by Utility

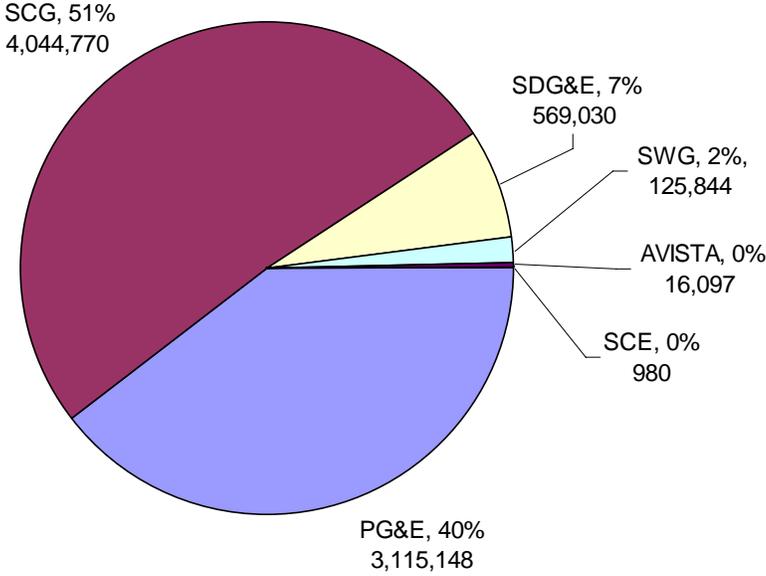


Figure 5

Repaired Leaks in California by Utility								
Year	Company	Corrosion	Third Party	Outside Force	Construction Defect	Material Defect	Other	Total
2000	PG&E	2,009	3415	113	1,288	516	2,014	9,355
2001		1,977	3589	161	1,565	508	1,656	9,456
2002		2,103	3483	157	1,471	588	1,527	9,329
2003		1,785	3495	143	1,279	497	1,042	8,241
SCG								
2000	SCG	4,336	5,032	287	466	270	2,438	12,829
2001		4,920	4726	284	461	304	2,752	13,447
2002		5,899	4820	341	480	295	3,581	15,416
2003		5,652	5159	207	462	273	2,869	14,622
SDG&E								
2000	SDG&E	391	727	186	147	136	89	1,676
2001		452	634	186	150	130	57	1,609
2002		443	617	130	118	112	98	1,518
2003		587	427	106	105	82	83	1,390
SWG								
2000	SWG	48	249	37	308	0	28	670
2001		30	260	50	558	0	40	938
2002		19	399	36	431	0	31	916
2003		13	273	20	217	1	26	550
AVISTA								
2000	AVISTA	1	38	0	0	0	0	39
2001		0	39	0	0	0	4	43
2002		0	56	0	0	0	0	56
2003		0	51	0	0	0	0	51
SCE								
2000	SCE	0	0	0	0	0	0	0
2001		0	3	0	0	0	0	3
2002		2	0	0	0	0	0	2
2003		0	0	0	0	0	0	0
2003	Total	8,037	9,405	476	2,063	853	4,020	24,854

Table 4

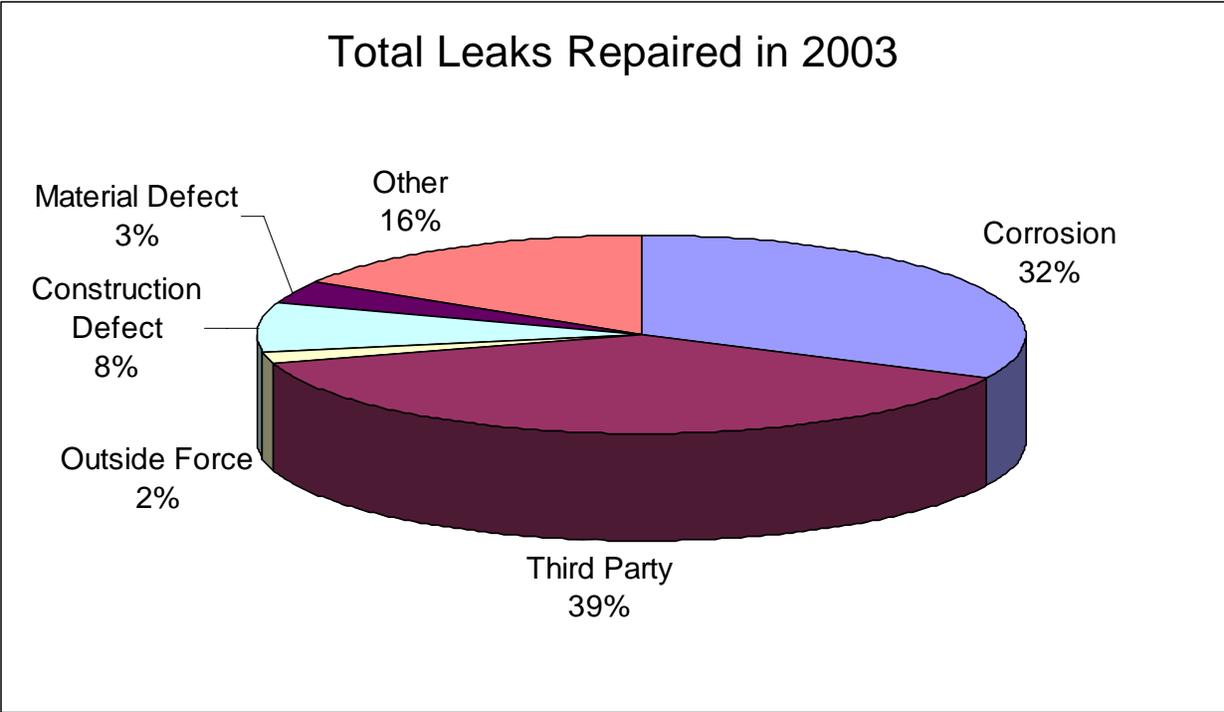


Figure 6

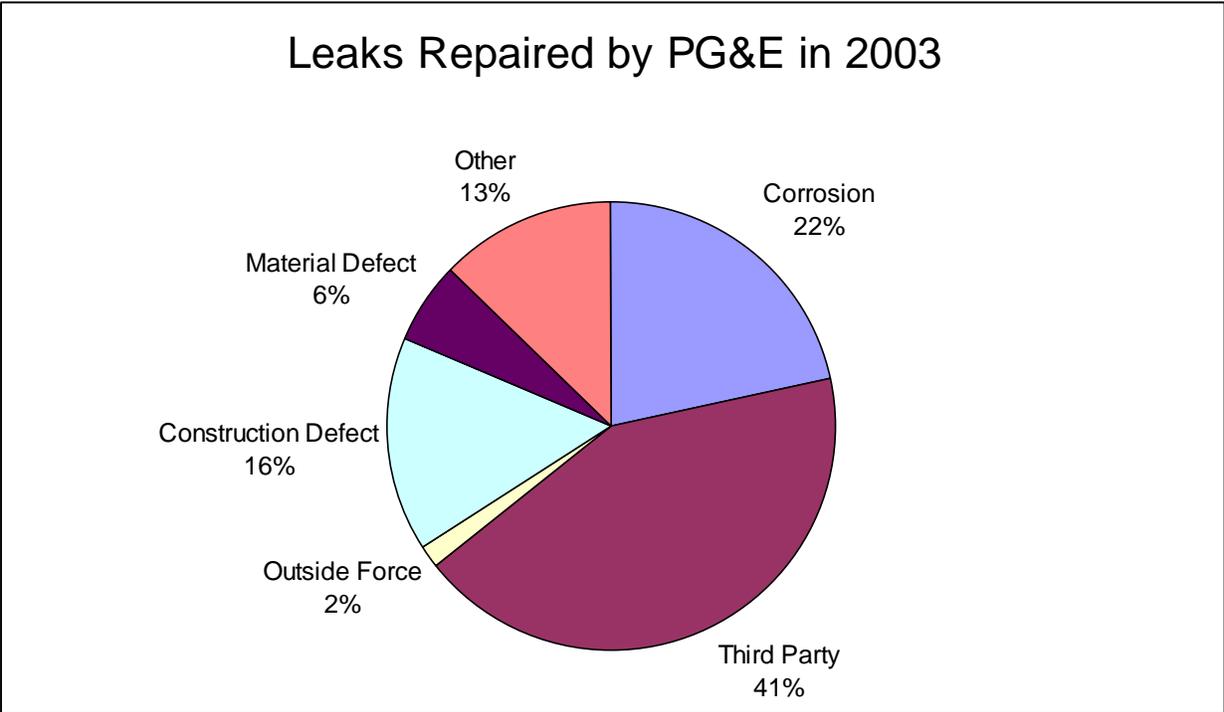


Figure 7

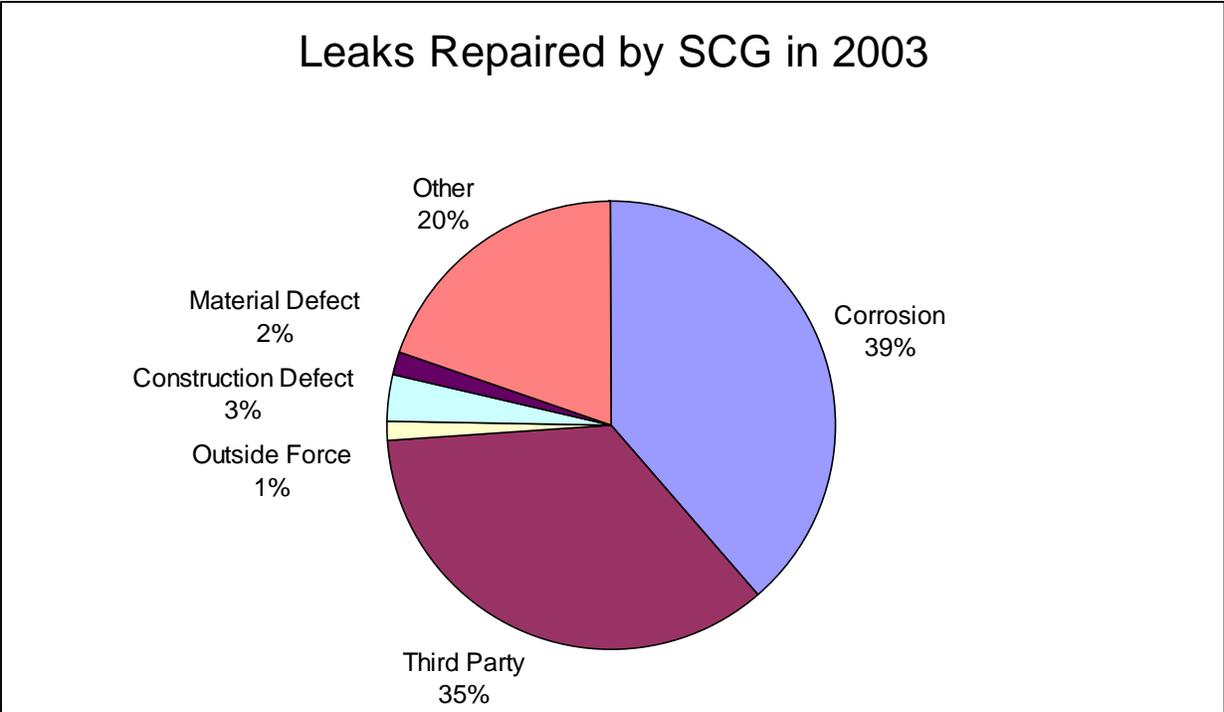


Figure 8

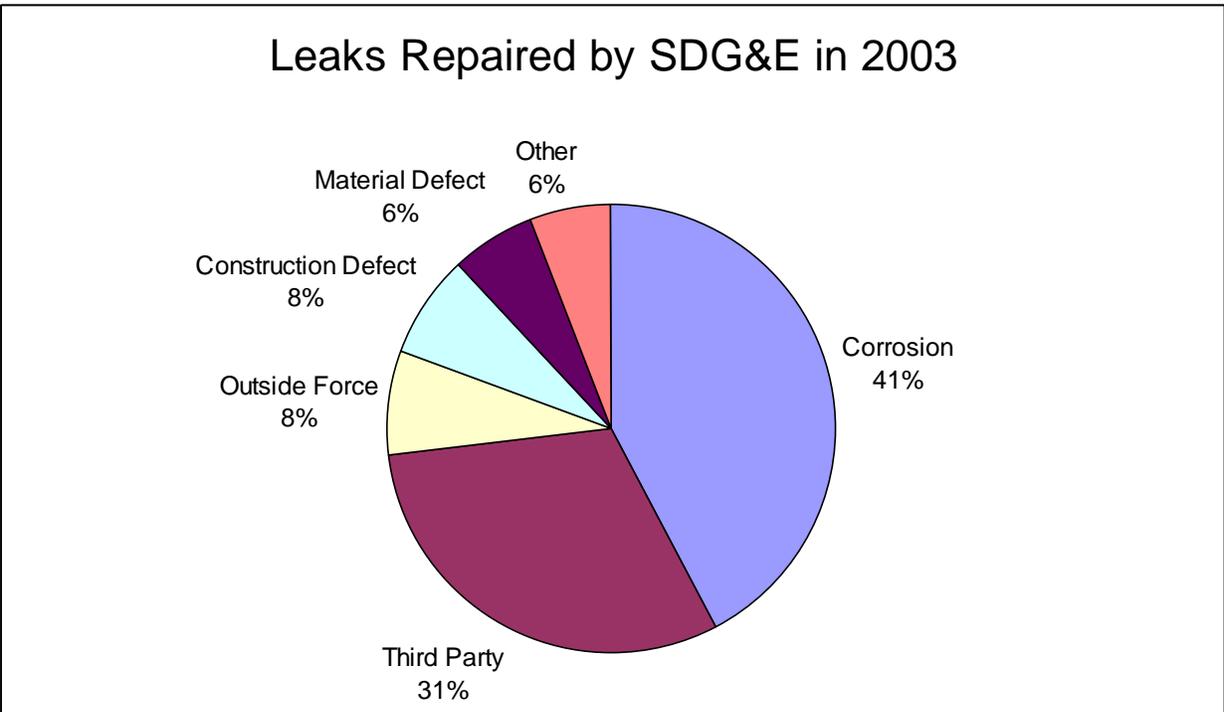


Figure 9

Leaks Repaired by SWG in 2003

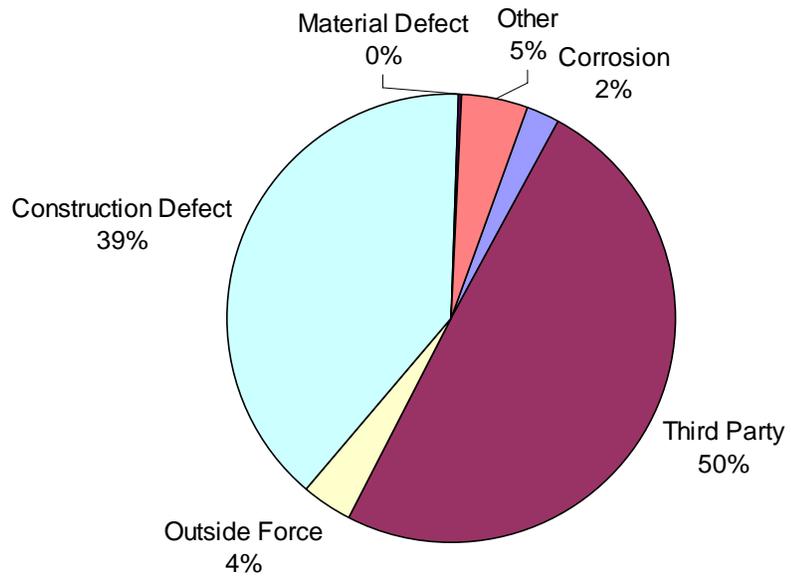


Figure 10



IV. USRB'S GAS STATISTICS 2000-2003

A. G.O. 112-E Inspection Areas

During 2000-2003, USRB personnel were divided into two units, and each unit was assigned specific counties in which to conduct G.O. 112-E inspections in California. The following lists the counties each unit covered:

Northern Unit: Alameda, Alpine, Amador, Butte, Calaveras, Colusa, Contra Costa, Del Norte, El Dorado, Fresno, Glenn, Humboldt, Inyo, Kern, Kings, Lake, Lassen, Madera, Marin, Mariposa, Mendocino, Merced, Modoc, Mono, Monterey, Napa, Nevada, Placer, Plumas, Sacramento, San Benito, San Francisco, San Luis Obispo, San Joaquin, San Mateo, Santa Barbara, Santa Clara, Santa Cruz, Shasta, Sierra, Siskiyou, Solano, Sonoma, Stanislaus, Sutter, Tehama, Trinity, Tuolumne, Tulare, Yolo and Yuba.

Southern Unit: Imperial, Los Angeles, Orange, Riverside, San Bernardino, San Diego and Ventura

A file is kept on each area inspected for a period of at least 3 years. Every unit of a major gas company and municipal utility is inspected every two or three years, or more often if the condition of the unit is unsatisfactory and not in compliance with federal law. MHP and propane systems are inspected once every 5 years unless the audit warrants more frequent inspection. Records are kept in both Los Angeles and San Francisco. The federal government audits USRB's records annually. Federal funding to the state is based on these results. During the last four years USRB has been receiving full funding (over \$1 million per year) as a result of its performance based on the federal audit. The federal government divides the total amount allocated to gas safety by Congress and distributes the amount based on cost of each state's gas safety program and score received on the annual audit. It typically is less (40-45%) than the 50% funding requested.

B. USRB Inspection Data

1. Summary of the G.O.112-E Inspections Conducted, 2000-2003

	2000	2001	2002	2003
Number of GO 112e Inspections Conducted	28	28	31	30
Number of MHP Inspections Conducted	554	282	320	188
Number of Propane Inspections Conducted	140	42	89	152
Number of Person-Days for GO 112e Inspections	477	416	365	244
Number of Person-Days for MHP Inspections	446	180	176.5	151.5
Number of Person-Days for Propane Inspections	143	46	57.5	89.5
Number of Inspection Violations Found during CY	2574	1442	2279	1643
Number of Inspection Violations Corrected during CY	1937	1005	1459	1255
Number of Engineers during each CY	19	19	18	18

Table 5

2. Tabulation of Utility Inspections Conducted, 2000-2003

	2000	2001	2002	2003
Alpine	1	0	1	0
Avista	1	0	1	0
Coalinga	0	1	0	1
Lodi Storage	0	0	0	1
Palo Alto	0	0	1	0
PG&E	13	14	13	15
SCG	11	10	11	9
SDG&E	1	2	2	2
SWG	0	1	1	1
West Coast Storage	1	0	1	0
Wild Goose Storage	0	0	0	1
TOTAL	28	28	31	30

Table 6

C. GAS INCIDENTS & CUSTOMER COMPLAINTS

The USRB staff receives and investigates reportable gas and propane incidents from regulated utility companies, MHP's, and Propane Parks. G.O. 112-E states reportable incidents are those which involve the release of gas and: (a) result in fatality or personal injury rising to the level of in-patient hospitalization and attributable or allegedly attributable to utility owned facilities; (b) cause over \$50,000 in damage including the loss of gas; and (c) are the subject of significant public attention or media coverage and are attributable or allegedly attributable to utility facilities.

The gas utility companies are required to provide notice to designated USRB staff within 2 hours of a reportable incident. The notice shall identify the time and date of the incident, the time and date of notice to the Commission, the location of the incident, casualties which resulted from the incident, identification of casualties and property damage, and the name and telephone number of a utility contact person.

The designated USRB staff is called the On-Call Engineer (OCE). The OCE is responsible for receiving reportable incidents from the utility companies. The OCE duties are shared amongst the USRB engineers and management. Each engineer assumes the OCE duties for an entire week (5 business days) during business hours several times per year, while USRB management assumes on-call duties after business hours and on weekends. The OCE may investigate incidents at any hour, including weekends.

In addition, the staff maintains a database of outages and accidents to note trends. If there is significant trending, the staff will investigate and work with utilities to correct the problem. The database can be very useful in noting trends about dig-ins by excavators, manufacturer defects, corrosion areas, and need for meter protection. The Commission has initiated Orders Instituting Investigation (OII's) based on the supporting data and investigations of USRB. USRB staff also may investigate customer complaints involving alleged violations of the General Orders, sometimes on behalf of Consumers Affairs Branch or through direct referral.

1. Reportable Incidents by Cause, 2000-2003

	2000	2001	2002	2003
Construction/ Material Defect	3	3	1	1
Corrosion	0	0	0	0
Dig-In	54	31	33	19
Outside Force	18	10	8	9
Vehicle	10	9	9	6
Total	85	53	51	35

Table 7

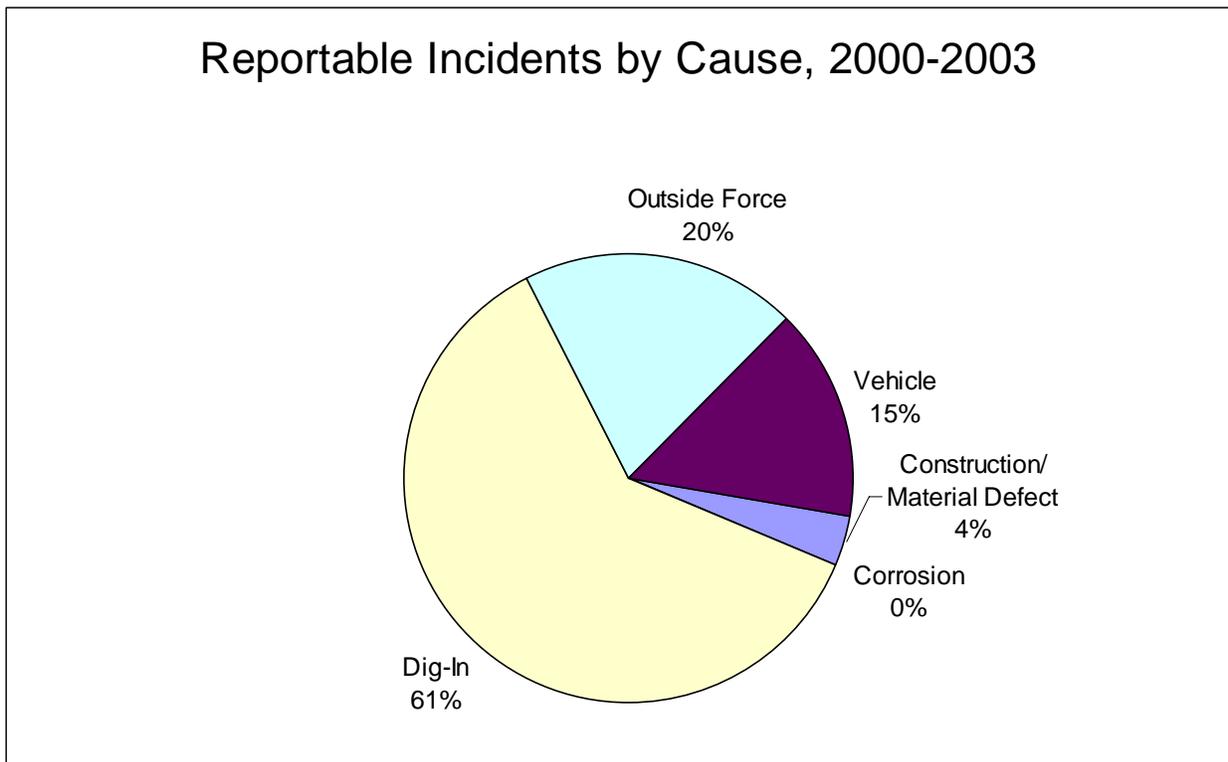


Figure 11

The pie chart above illustrates that “dig-ins” were the predominant cause of gas incidents comprising 61% of all gas incidents reported to the CPUC during 2000-2003. The utilities also send USRB a list of their non-reportable incidents where the percentage of “dig-ins” jumps to 85-95% of the number of the total incidents. This is the main reason the federal government and

the CPUC have worked together to improve the one-call system which requires contractors to call before they dig. This legislated program requires excavators to notify Underground Service Alert (USA) when and where they are going to dig, bore or drill. USA notifies the utility companies that have facilities in the area. The utilities are given 2 business days to locate and mark their facilities in the proposed construction area before the contractor excavates. Rarely are the facilities marked incorrectly, but it does happen. Most of the damage is caused by contractors that choose to not call, dig before the facilities are marked, fail to hand dig in areas that are marked or erase markings during the course of construction.

“Outside force” accounted for 20% and “Vehicle damage” (which is also an “Outside Force” that USRB has counted separately) accounts for another 15%. Corrosion leaks are mainly discovered and repaired as a result of routine leak surveys and patrolling. In essence this graph shows the need for the “One-Call” (USA) system (“Dig-ins”) and the meter protection program (“Vehicles”).

As stated earlier, there are many incidents that occur on utility systems which are not reportable because they are minor and do not meet the requirements set forth by the federal government nor the state of California to be reported. However, the CPUC requires the gas companies to submit quarterly reports detailing all incidents where gas is released. Approximately 90% of the quarterly reported incidents are caused by a form of excavation such as boring, trenching, farm equipment plowing, landscaping, gardening, etc. Approximately half of the dig-ins are caused by people who did not notify USA. Most of these people are small contractors or homeowners and/or their helpers who hit service lines while working in their yard. Many of these people are unaware that USA exists and that they are required to call USA in order to be in compliance with the state law.



V. ADDITIONAL INFORMATION

A. PUBLICATIONS

Copies of G.O. 112-E are available to the general public from the CPUC. Copies of federal regulations regarding pipeline safety must be obtained from the federal government. A form to obtain this information is on the last page of G.O. 112-E.

1. How to Order G.O. 112-E by Phone or Mail

Call or write to:

Documents, California Public Utilities Commission
505 Van Ness Avenue
San Francisco, CA 94102
(415) 703-1713

California Public Utilities Commission (most documents available)
320 West 4th Street, Suite 500
Los Angeles, CA 90013
(213) 576-7020

2. How to Order G.O. 112-E and Federal Regulations Internet

- Can be viewed on the internet at <http://www.cpuc.ca.gov> (click on regulations).
- Federal Regulations can be viewed on the internet at <http://ops.dot.gov/regsindex.htm>